

## Data sheet

# Floor Heating Manifold FHF

### Application


The Manifold FHF is used for controlling water flow in under floor heating systems. Each tube of the floor heating system is connected to the manifold, thus making it possible to control water flow or heat supply to each room in the building individually.

The manifold consists of a supply and return manifold. The supply manifold includes possibility for individual shut-off of each circuit and as an option also flowmeter. The return manifold is equipped with integrated Danfoss pre-setting valves securing optimal hydraulic balance in the system.


The valves can be controlled electronically by thermal actuators or act as self-acting units by means of remote temperature adjusters.

The manifold is supplied in modules of up to 12 outlets. In addition extension pieces are available for connecting the manifolds in series. Ball valves are available as an option for positive shut-off between manifold and system.

The end pieces FHF-EM and FHF-EA are supplied with manual airvent or alternatively with automatic airvent, purge valve. The end pieces are placed at the end of the manifold.

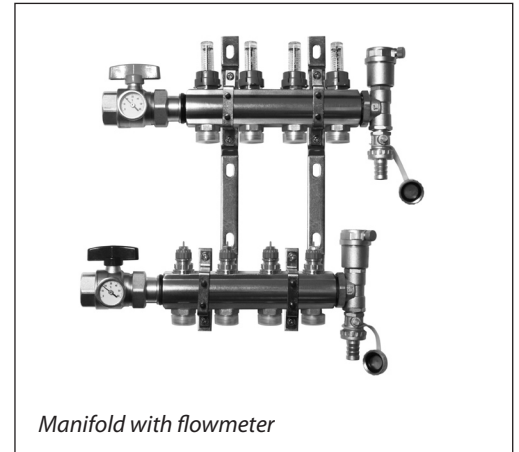


*Manifold with flowmeter*

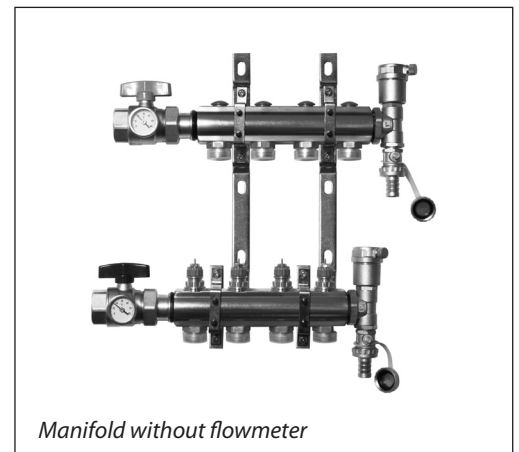

*Manifold without flowmeter*





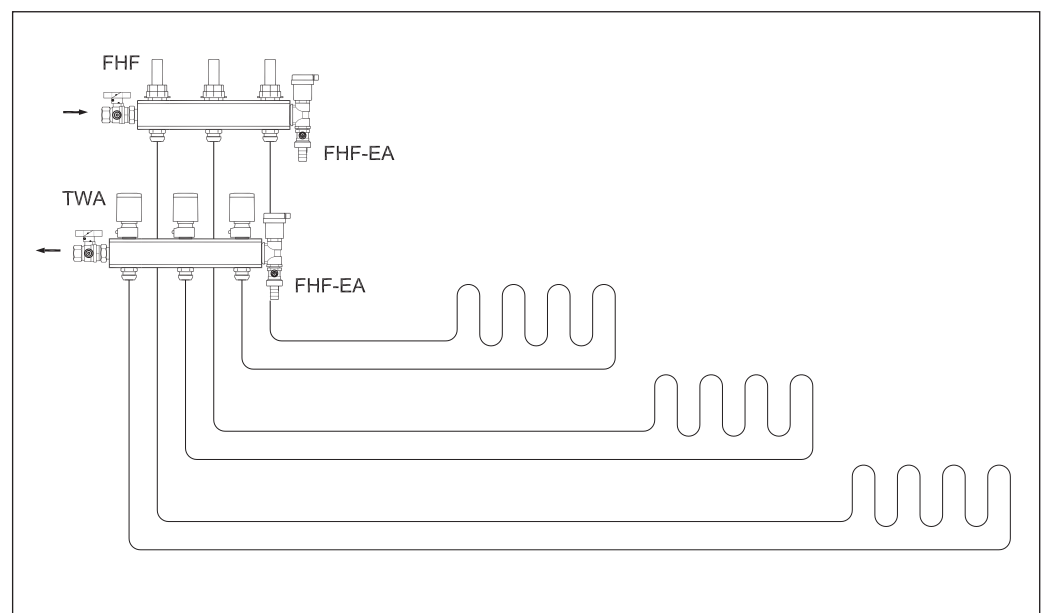




### System layout



Ordering

Description	Type	Code no.
	Manifold set 2+2	FHF-2 <b>088U0502</b>
	Manifold set 3+3	FHF-3 <b>088U0503</b>
	Manifold set 4+4	FHF-4 <b>088U0504</b>
	Manifold set 5+5	FHF-5 <b>088U0505</b>
	Manifold set 6+6	FHF-6 <b>088U0506</b>
	Manifold set 7+7	FHF-7 <b>088U0507</b>
	Manifold set 8+8	FHF-8 <b>088U0508</b>
	Manifold set 9+9	FHF-9 <b>088U0509</b>
	Manifold set 10+10	FHF-10 <b>088U0510</b>
	Manifold set 11+11	FHF-11 <b>088U0511</b>
	Manifold set 12+12	FHF-12 <b>088U0512</b>
		Manifold set 2+2, with flowmeter
Manifold set 3+3, with flowmeter		FHF-3F <b>088U0523</b>
Manifold set 4+4, with flowmeter		FHF-4F <b>088U0524</b>
Manifold set 5+5, with flowmeter		FHF-5F <b>088U0525</b>
Manifold set 6+6, with flowmeter		FHF-6F <b>088U0526</b>
Manifold set 7+7, with flowmeter		FHF-7F <b>088U0527</b>
Manifold set 8+8, with flowmeter		FHF-8F <b>088U0528</b>
Manifold set 9+9, with flowmeter		FHF-9F <b>088U0529</b>
Manifold set 10+10, with flowmeter		FHF-10F <b>088U0530</b>
Manifold set 11+11, with flowmeter		FHF-11F <b>088U0531</b>
Manifold set 12+12, with flowmeter		FHF-12F <b>088U0532</b>
		End section - automatic airvent and purge valve
	End section - manual airvent and purge valve	FHF-EM <b>088U0581</b>
	End caps -set	FHF-E <b>088U0582</b>
	Connection pieces - set	FHF-C <b>088U0583</b>
	Reduction bushes/pieces -set 1" - 3/4"	FHF-R <b>088U0584</b>

Ordering

Description	Type	Code no.
 <p>Mounting brackets - set</p>	FHF-MB	<b>088U0585</b>
 <p>2 x ball valve 1" with tail piece - for connection to manifold and for blocking of floor heating system</p>	FHF-BV	<b>088U0586</b>
 <p>1 x thermometer 0-60°C Ø35mm - for flow/return temperature measurement</p>	FHD-T	<b>088U0029</b>
 <p>Thermal actuator, 24V, NC, Danfoss RA connection to valve</p>	TWA-A	<b>088H3110</b>
 <p>Thermal actuator, 230V, NC, Danfoss RA connection to valve</p>	TWA-A	<b>088H3112</b>
 <p>Thermal actuator, 24V, NC, with end switch, Danfoss RA connection to valve</p>	TWA-A	<b>088H3114</b>
 <p>Compression fittings for <b>PEX</b> tubing in accordance with ISO 15875.</p> <p>Max working pressure: 6 bar Test pressure: 10 bar Max. flow temperature: 95 °C G 3/4" internal thread</p> <p>Max. flow temperature given by the tube manufacturer must not be exceeded.</p> <p><sup>1)</sup> Compression fittings also suitable for <b>PERT</b> tubing in accordance with ISO 15875.</p>	12x2 mm	<b>013G4152</b>
	13x2 mm	<b>013G4153</b>
	14x2 mm	<b>013G4154</b>
	15x2.5 mm	<b>013G4155</b>
	16x1.5 mm	<b>013G4157</b>
	16x2 mm	<b>013G4156 <sup>1)</sup></b>
	16x2.2 mm	<b>013G4163</b>
	17x2 mm	<b>013G4162</b>
	18x2 mm	<b>013G4158</b>
	18x2.5 mm	<b>013G4159</b>
	20x2 mm	<b>013G4160</b>
	20x2.25 mm	<b>013G4093 <sup>1)</sup></b>
20x2.5 mm	<b>013G4161</b>	
 <p>Compression fittings for <b>ALUPEX</b> tubing.</p> <p>Max working pressure: 6 bar Test pressure: 10 bar Max flow temperature: 95 °C G 3/4" Internal thread</p> <p>Max flow temperature given by the tube manufacturer must not be exceeded.</p> <p><sup>2)</sup> Compression fittings also suitable for <b>PERT/ALU/PERT</b> tubing.</p>	12x2 mm	<b>013G4182</b>
	14x2 mm	<b>013G4184</b>
	15x2.5 mm	<b>013G4185</b>
	16x2 mm	<b>013G4186<sup>2)</sup></b>
	16x2.25 mm	<b>013G4187</b>
	18x2 mm	<b>013G4188</b>
	20x2 mm	<b>013G4190</b>
	20x2.25 mm	<b>013G4093<sup>2)</sup></b>
20x2.5 mm	<b>013G4191</b>	
 <p>Compression fittings for <b>STEEL</b> and <b>COPPER</b> tubing</p> <p>Max working pressure: 6 bar Test pressure: 10 bar Max flow temperature: 120 °C G 3/4" Internal thread</p>	10 mm	<b>013G4120</b>
	12 mm	<b>013G4122</b>
	14 mm	<b>013G4124</b>
	15 mm	<b>013G4125</b>
	16 mm	<b>013G4126</b>
	18 mm	<b>013G4128</b>



**Capacity/ commissioning**

The pre-setting of the manifold valves determines the flow in the floor heating tubes and is therefore an important factor for obtaining optimal hydraulic balance in the system. A correct hydraulic

balance is important if optimal comfort shall be achieved with a minimum of energy consumption and is easily carried out following the example shown below.

**Example**


<b>Room 1</b>	1	Determine longest tube/largest room	25 m <sup>2</sup>
	2	Desired cooling (ΔT)	5 °C (typical)
	3	Determine heat requirement for the room	50 W/m <sup>2</sup>
	4	Conversion factor	1.16
	5	Calculation of flow for the room	$Q \text{ (l/h)} = \frac{50 \text{ W/m}^2 \times 25 \text{ m}^2}{5 \text{ °C} \times 1.16}$ $Q \text{ (l/h)} = \underline{216 \text{ l/h}}$
<b>Room 2</b>	6	Determine area for the next room	15 m <sup>2</sup>
	7	Calculation of flow for the room (ΔT and heat requirement is assumed identical for the rooms in this case)	$Q \text{ (l/h)} = \frac{50 \text{ W/m}^2 \times 15 \text{ m}^2}{5 \text{ °C} \times 1.16}$ $Q \text{ (l/h)} = \underline{129 \text{ l/h}}$

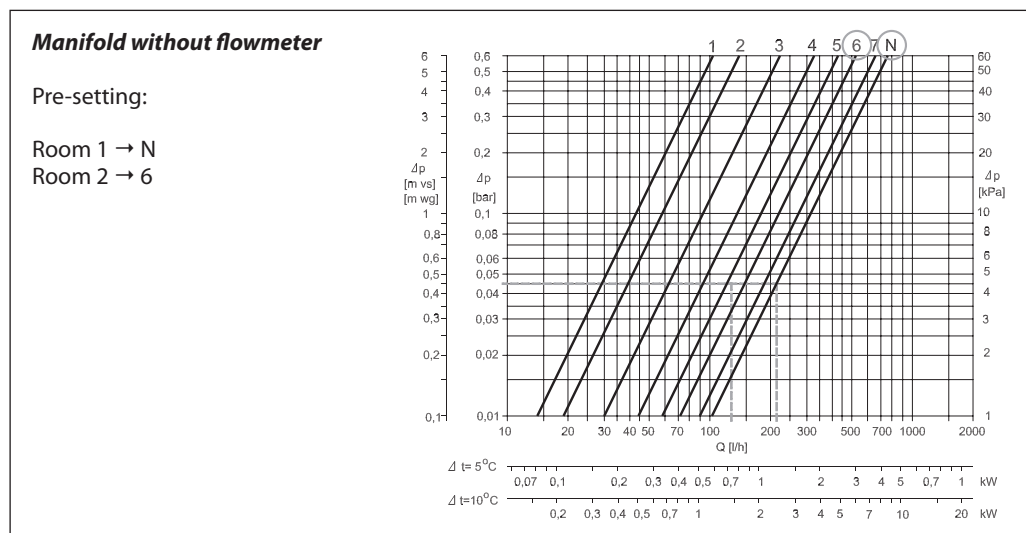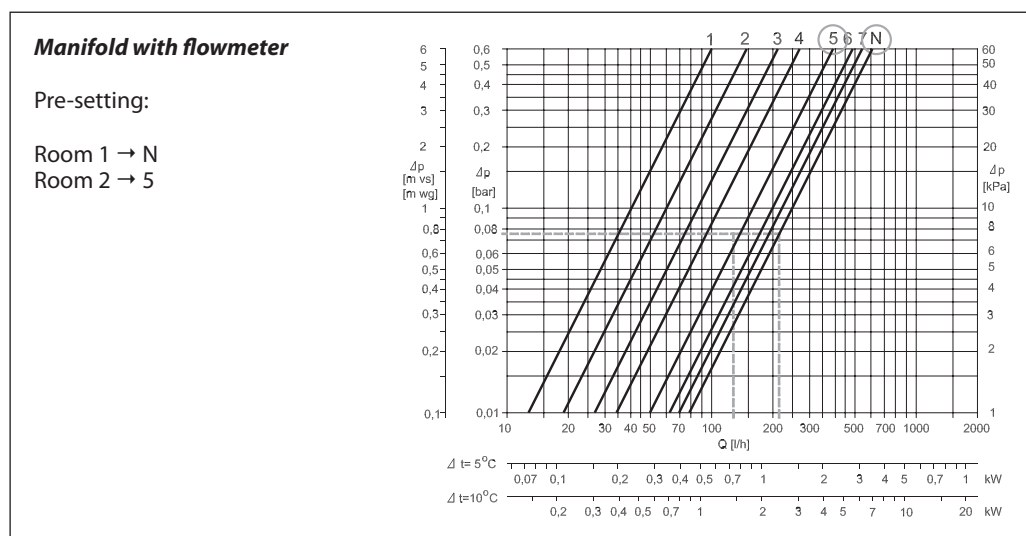

**Pre-setting the manifold valves**

The diagrams shows the capacities for each heating circuit at different pre-settings of the manifold valves. Please note that the capacities are slightly different depending on whether a manifold with flowmeter or a manifold without flowmeter has been chosen. Based on the above calculations

and capacity diagrams each manifold valve is pre-set by rotating the red ring until the correct value on the ring is in-line with the sight mark on the valve.

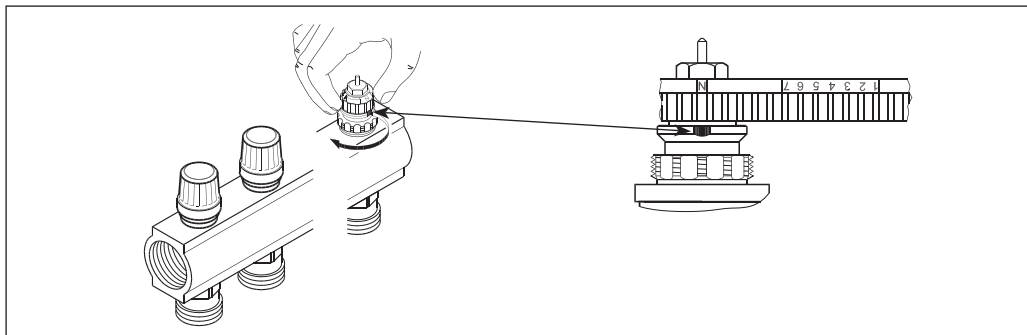

**Design**

	Item	Description	Material
<p>Supply manifold with flowmeter</p>	1	Sightglass	Heat resistant plastic
	2	Flowmeter nut	Brass, CuZn39Pb3
	3	Flowmeter insert	Brass, CuZn39Pb3
	4	Supply manifold body	Brass, CuZn40Pb2
	5	O-ring	EPDM
	6	Union for compression fitting	Brass, CuZn40Pb2


	Item	Description	Material
<p>Supply manifold without flowmeter</p>	1	Lock washer	Brass, CuZn40Pb2
	2	O-ring	EPDM
	3	Valve spindle	Brass, CuZn40Pb2
	4	O-ring	EPDM
	5	Valve tube	Brass, CuZn40Pb2
	6	Supply manifold body	Brass, CuZn40Pb2
	7	O-ring	EPDM

	Item	Description	Material
<p>Return manifold with control valve</p>	1	Gland seal	-
	2	Pre-setting ring	PBT
	3	Valve body	Brass, CuZn40Pb2
	4	Return manifold body	Brass, CuZn40Pb2
	5	K <sub>v</sub> insert	Brass, CuZn39Pb3
	6	O-ring	EPDM
	7	Union for compression fitting	Brass, CuZn40Pb2


Operation conditions

Max differential pressure: 0.6 bar  
 Max working pressure: Manifold without flowmeter 10 bar / Manifold with flowmeter 6 bar  
 Max test pressure: Manifold without flowmeter 16 bar / Manifold with flowmeter 10 bar  
 Max flow temperature: 90 °C

Dimensions

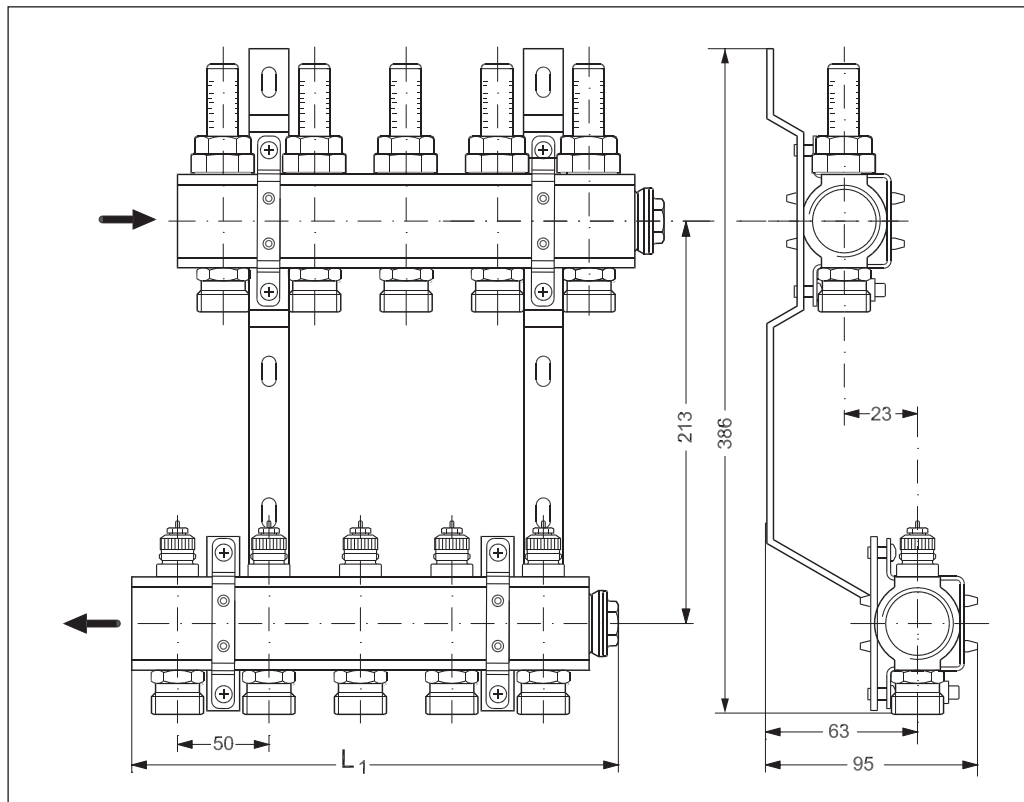

<b>Type</b>	2+2	3+3	4+4	5+5	6+6	7+7	8+8	9+9	10+10	11+11	12+12
<b>L1 (mm)</b>	111	161	211	261	311	361	411	461	511	561	611

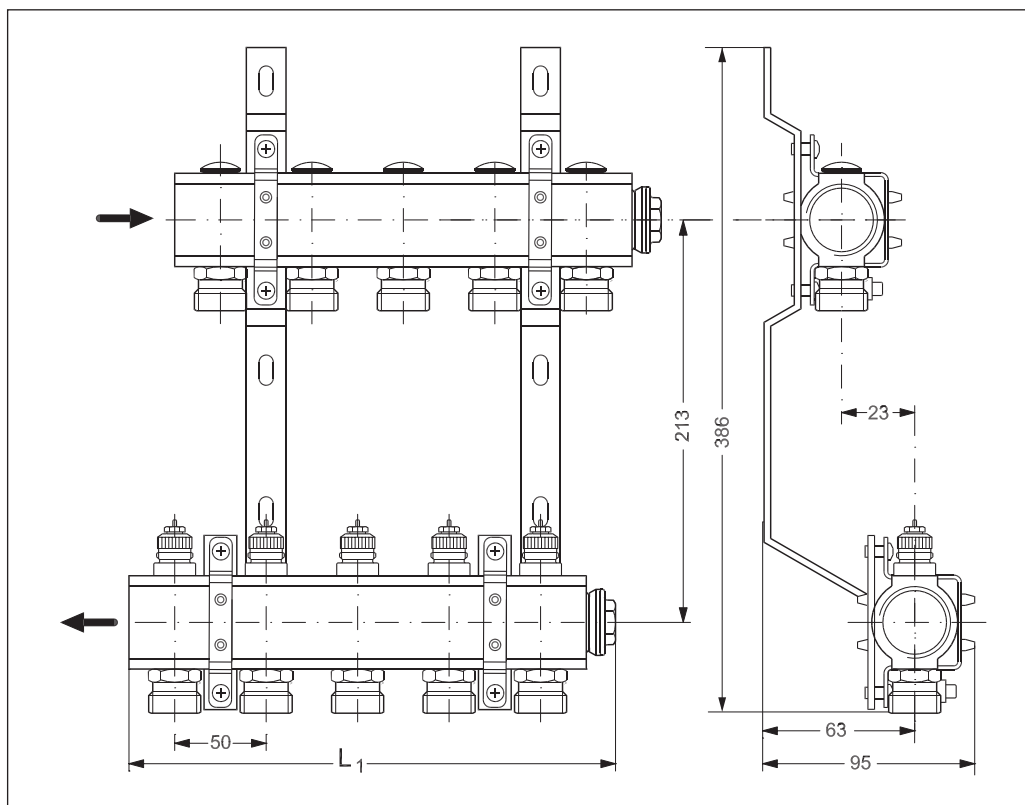

Type	2+2	3+3	4+4	5+5	6+6	7+7	8+8	9+9	10+10	11+11	12+12
L1 (mm)	111	161	211	261	311	361	411	461	511	561	611

